

# UEM63-4D R70

## 63A three phase energy meter with built-in communication

- For RS485 Modbus RTU/ASCII communication
- Direct connection up to 63 A
- Up to 70°C operating temperature
- Fully bi-directional 4-quadrant measurements for all energies and powers
- For 4 wire networks with balanced or unbalanced load
- Class B according to EN 50470-3 (MID)
- S0 output for energy pulse emission
- Available with MID certification



### » General features

4 DIN modules energy meter for the energy measurement in industrial and civilian application, with RS485 Modbus RTU/ASCII built-in communication. Available with MID certification suitable for billing.

Besides the energy, the meter can measure the main electrical parameters and makes them available on the built-in COM port. The LCD display shows the energies and the instantaneous powers. The COM port allows to manage the connected meter by a remote station. Data is transmitted on a RS485 line. Moreover, a dedicated application for remote management is provided:

- *Modbus Master software* > for energy meter management by PC in RS485 Modbus network.

The meter is built according to EN 50470-1 standard. The active energy is compliant to IEC/EN 62053-21 class 1, but for MID certified device it moreover fulfills class B requirements according to EN 50470-3. The accuracy of reactive energy is compliant to IEC/EN 62053-23 class 2.

Wide backlit LCD display with clear graphic symbols comprehensible at a glance. Metrological LED on front panel and sealable terminal covers. The analysis of the MTBF values, the accurate selection of components and the reduction of the internal working temperatures together with strict production and control standards guarantee a product with an excellent quality and a long lasting reliability.

### » Applications

- Totalization of the electric energy in the industry for each single line or machine.
- Measurement of energy generated by renewable sources such as solar, eolic, etc.
- Accounting and billing of consumptions in camp sites, malls, residential areas, naval ports, etc.
- Totalization of the electric consumption in hotels, congress centers, exhibition fairs.
- Accounting of the consumptions in buildings with executive office services.
- Internal allocation of the consumptions in timeshare civilian and industrial buildings.
- Realization of energy monitoring systems.
- Remote survey of the consumptions and compute of the costs.

### » Benefits

- Remote management through dedicated application/interface.
- Up to 30 instantaneous measurements, complete set of energy counters and partial counters. Moreover partial counters can be started, stopped or reset.
- Phase sequence and diagnostic function for error signalling in case of wrong polarity connection.
- Available MID according to Swiss market (MID S). Reactive energy is not shown on energy meter display.

### » Related products

- Modbus Master software (for Windows OS)

## » Technical features

### Power supply

- Power supplied from the voltage circuit
- Nominal measurement voltage  $\pm 20\%$
- Max consumption (for each phase): 3.5 VA - 1 W
- Nominal frequency: 50/60 Hz

### Voltage range & frequency

- 3x230/400 ... 3x240/415 V 50/60 Hz

### Current

- Starting current  $I_{st}$ : 20 mA
- Minimum current  $I_{min}$ : 250 mA
- Transitional current  $I_{tr}$ : 500 mA
- Reference current  $I_{ref}$  ( $I_b$ ): 5 A
- Maximum current  $I_{max}$ : 63 A

### RS485 Modbus communication

- Port: RS485
- Protocol: Modbus RTU/ASCII
- Communication speed: 300 ... 57600 bps

### Accuracy

- Active energy class 1 according to IEC/EN 62053-21 (NO MID)
- Active energy class B according to EN 50470-3 (MID)
- Reactive energy class 2 according to IEC/EN 62053-23

### S0 output

- Passive optoisolated
- Maximum values: 27 V<sub>DC</sub> - 27 mA
- Meter constant: 100 imp/kWh  
The measuring unit (imp/kWh, imp/kvarh, imp/kVAh) changes according to the assigned counter (kWh, kvarh, kVAh)
- Pulse length: 50  $\pm$ 2ms

### Tariff input

- Active optoisolated
- Voltage range for tariff 2: 80 ... 276 V<sub>AC-DC</sub>


### Metrological LED

- Meter constant: 1000 imp/kWh
- Pulse length: 10  $\pm$ 2ms

### Environmental conditions

- Operating temperature: -25°C ... +70°C
- Storage temperature: -25°C ... +75°C
- Humidity: 80% max without condensation
- Protection degree: IP51 frontal part -IP20 terminals

## » Technical drawing (mm)

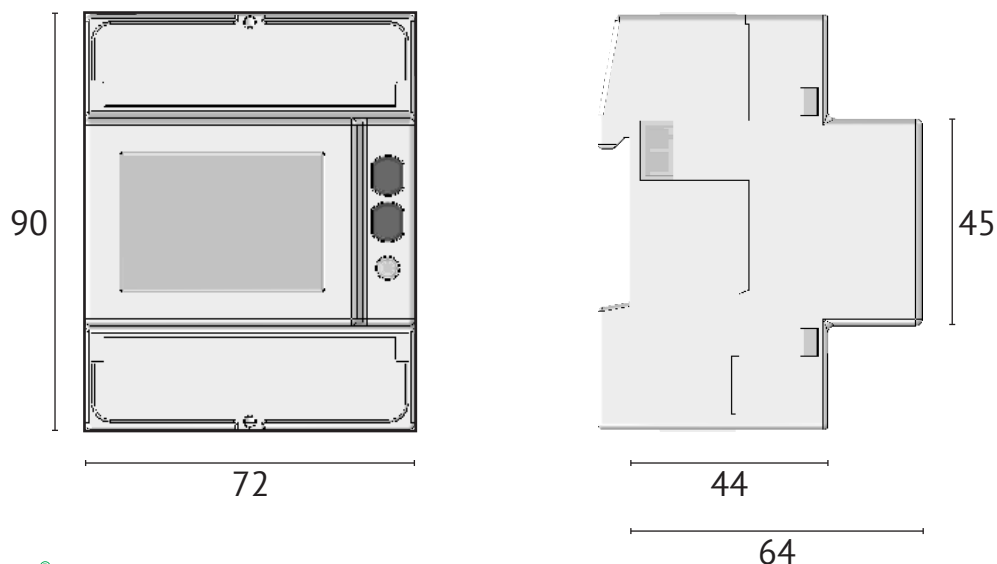


## » Measurements

	SYMBOL	MEASURE UNIT, VALUE or STATUS	4 WIRE SYSTEM	DISPLAY	COM PORT
<b>INSTANTANEOUS VALUES</b>					
Phase voltage	$V_{L1-N} - V_{L2-N} - V_{L3-N}$	V	●		●
Line voltage	$V_{L1-L2} - V_{L2-L3} - V_{L3-L1}$	V	●		●
System voltage	$V_{\Sigma}$	V	●		●
Phase current	$I_1 - I_2 - I_3$	A	●		■
Neutral current	$I_N$	A	●		■
System current	$I_{\Sigma}$	A	●		■
Phase power factor	$PF_{L1} - PF_{L2} - PF_{L3}$	-	●		●
System power factor	$PF_{\Sigma}$	-	●		●
Phase apparent power	$S_{L1} - S_{L2} - S_{L3}$	kVA	●	■	■
System apparent power	$S_{\Sigma}$	kVA	●	■	■
Phase active power	$P_{L1} - P_{L2} - P_{L3}$	kW	●	■	■
System active power	$P_{\Sigma}$	kW	●	■	■
Phase reactive power	$Q_{L1} - Q_{L2} - Q_{L3}$	kvar	●	■	■
System reactive power	$Q_{\Sigma}$	kvar	●	■	■
Frequency	f	Hz	●		●
Phase sequence	CW/CCW	-	●	●	●
Power direction	$\rightarrow$ $\leftarrow$	-	●	●	●
<b>RECORDED DATA</b>					
Phase active energy	L1 - L2 - L3	kWh	●	■	■
System active energy	$\Sigma$	kWh	●	■	■
Phase inductive and capacitive reactive energy	L1 - L2 - L3	kvarh	●	■❖	■
System inductive and capacitive reactive energy	$\Sigma$	kvarh	●	■❖	■
Phase inductive and capacitive apparent energy	L1 - L2 - L3	kVAh	●	■	■
System inductive and capacitive apparent energy	$\Sigma$	kVAh	●	■	■
Tariff 1/2 phase active energy	L1 - L2 - L3	kWh	●	■	■
Tariff 1/2 system active energy	$\Sigma$	kWh	●	■	■
Tariff 1/2 phase ind. and cap. reactive energy	L1 - L2 - L3	kvarh	●	■❖	■
Tariff 1/2 system ind. and cap. reactive energy	$\Sigma$	kvarh	●	■❖	■
Tariff 1/2 phase ind. and cap. apparent energy	L1 - L2 - L3	kVAh	●	■	■
Tariff 1/2 system ind. and cap. apparent energy	$\Sigma$	kVAh	●	■	■
Resettable partial energy counters	$\Sigma$	kWh, kvarh, kVAh	●	■❖	■
Energy balance	$\Sigma$	kWh, kvarh, kVAh	●	■❖	■
<b>OTHER INFORMATION</b>					
Present tariff	T	1/2			●
Undervoltage/overvoltage	VOL, VUL	ON/OFF			●
Undercurrent/overcurrent	IOL, IUL	ON/OFF			●
Frequency out of range	f <sub>OUT</sub>	ON/OFF			●
Partial counters	PAR	START/STOP		●	●
S0 output status	$\int$	Active		●	
<b>LEGEND:</b> ● = Available ■ = Bidirectional value ❖ = varh not available for MID S meter					

ORDER CODE	VOLTAGE AND FREQUENCY INPUT	COMMUNICATION PORT	OPTIONS			
			Self-powered	RS485 MODBUS	MID	MIDS
<b>UEM63-4D R70</b>						
1115.0001.0001	3x230/400V...3x240/415V 50/60Hz	●	●			
1115.0002.0001	3x230/400V...3x240/415V 50/60Hz	●		●		
1115.0003.0001	3x230/400V...3x240/415V 50/60Hz	●			●	
1115.0004.0001	3x230/400V...3x240/415V 50/60Hz	●				●

**LEGEND**

**MID:** MID certified meter, with reset function only on partial counters.  
**MIDS:** MID certified meter, with reset function only on partial counters, without reactive energy counters on display (only SWITZERLAND ).  
**NO MID:** Meter without MID certification, with reset function only on partial counters.  
**RESET:** Meter without MID certification, with RESET function on ALL counters.  
 Software for meter remote management (MODBUS Master) downloadable for free at [www.algodue.com](http://www.algodue.com)  
 A multilingual manual with English, German, Italian, French, Spanish is provided.

NOTE: Subject to change without notice



Innovative Electronic Systems

Via P. Gobetti, 16/F - 28014 Maggiora (NO) - Italy - Tel.: +39 0322 89307

sales@algodue.it - [www.algodue.com](http://www.algodue.com)

72PG01\_2\_202001\_5